

INDOOR / INDUSTRIAL / TUBEPROOF / TUBEPROOF


Item code 86.I008.2403.01





- Installation, inspection, and maintenance of luminaires should be performed by a qualified electrician.
- DO NOT make or alter any open holes in the luminaire. Do not modify the luminaire.
- DO NOT install damaged product.
- Make sure electrical power is OFF before and during installation and maintenance.
- Make sure the equipment is properly grounded.
- Make sure the supply voltage is same as the rated fixture voltage.

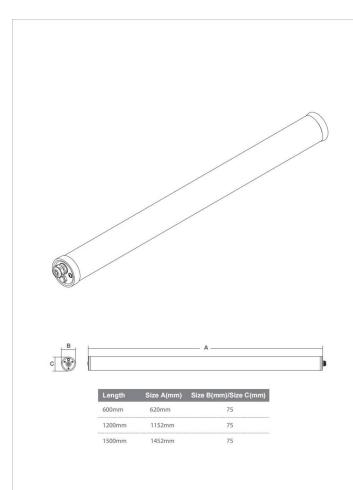


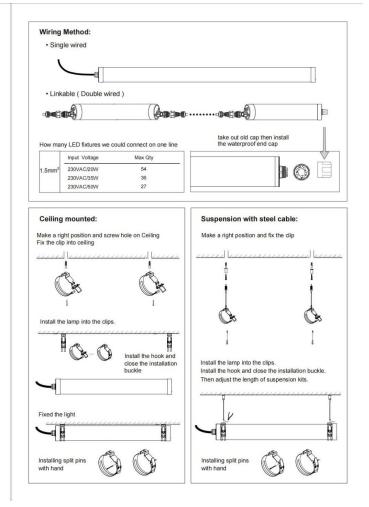



Item code 86.1008.2403.01



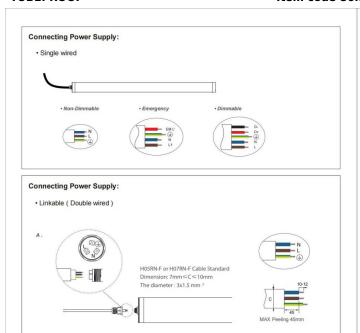

H05RN-F or H07RN-F Cable Standard Dimension: 10mm \leq C \leq 14mm The diameter: 5x1.5 mm 2

