
INDOOR / INDUSTRIAL / MARKETLINE / **MARKETLINE LUMINAIRES**

Item code 86.ML01.1415.01





- Installation and wiring of luminaire must be in accordance with all applicable local codes.
- Installation, inspection, and maintenance of luminaires should be performed by a qualified
- DO NOT make or alter any open holes in the luminaire. Do not modify the luminaire.
- DO NOT install damaged product.
- Make sure electrical power is OFF before and during installation and maintenance.
- Make sure the equipment is properly grounded.
- Make sure the supply voltage is same as the rated fixture voltage.

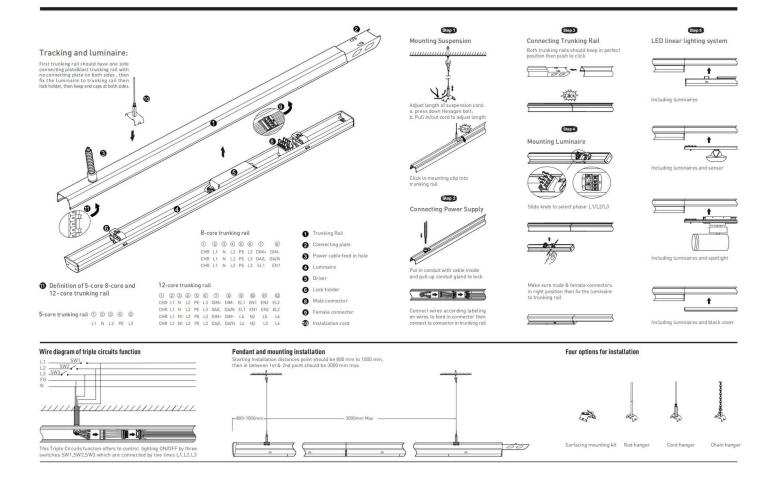



INDOOR / INDUSTRIAL / MARKETLINE / **MARKETLINE LUMINAIRES**

Item code 86.ML01.1415.01





- Make sure no voltage while installation
 Connect cable wires according to wire labeling
- Max current should not exceed 16A in one power feed in circuit.

