



- **Installation and wiring of luminaire must be in accordance with all applicabie local codes.**
- **Installation,inspection,and maintenance of luminaires should be performed by a qualified electrician.**
- **DO NOT make or alter any open holes in the luminaire Do not modify the luminaire.**
- **DO NOT install damaged product.**
- **Make sure electrical power is OFF before and during installation and maintenance.**
- **Make sure the equipment is properly grounded.**
- **Make sure the supply voltage is same as the rated fixture voltage.**

Single-Strut Mount


Unit: mm/inch



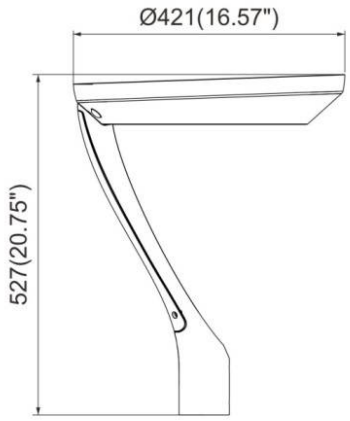


1.

M8
2PCS
6
8N.m

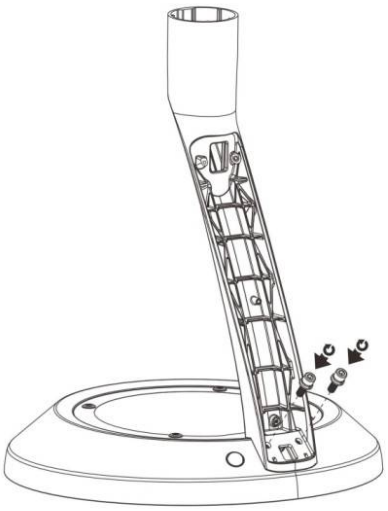


2.

M4
2PCS
1.2 N.m

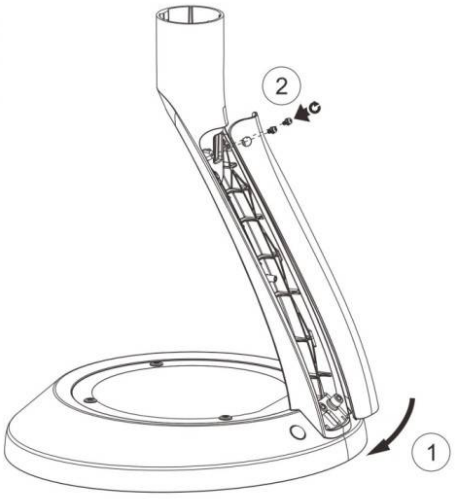

3.

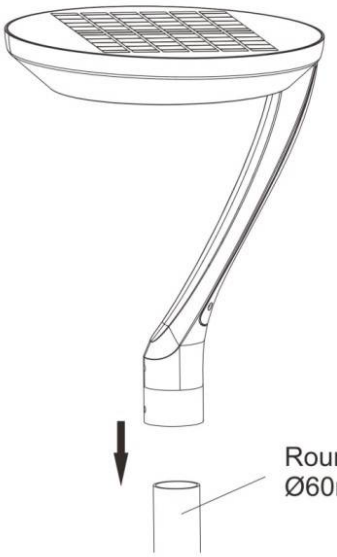

4.

M10x16
2PCS
5
17N.m

