
**Code article 86.OB10.1312.02**




# Instruction Manual

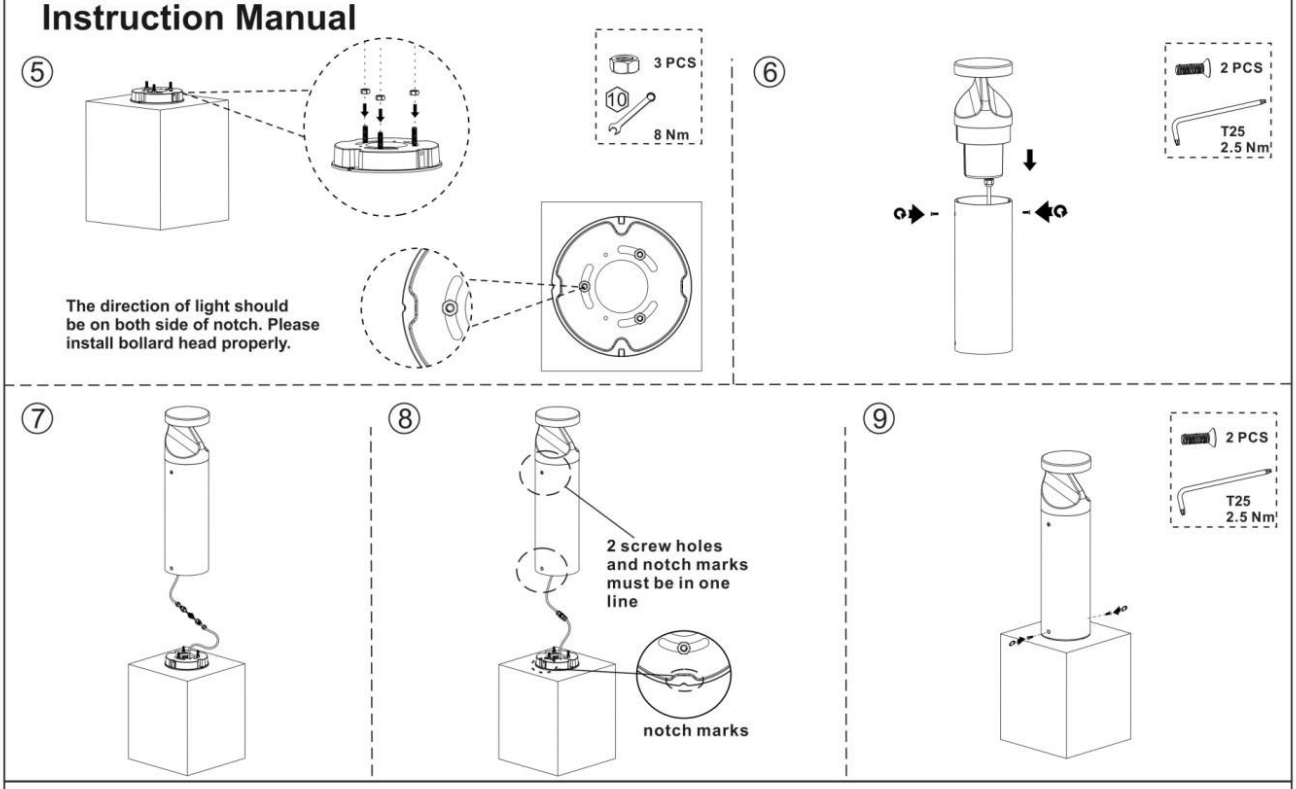



## PIR sensor detection coverage

**The light keeps 100% when presence is detected for 3 minute hold time, then turn off if no presence detected.**

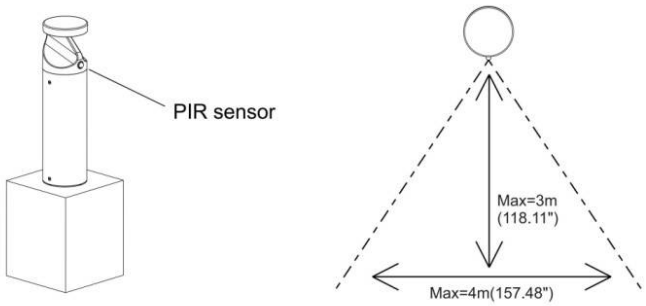


| Product Specifications | | 15W | | 25W | |
|---|---|---|---|---|---|
| Input Voltage | | 100-277 Vac/120-277 Vac/100-240 Vac/220-240 Vac (Subject to the input voltage on nameplate) | | | |
| Power Frequency | | 50 / 60 Hz | | | |
| Outlook Dimensions | | Ø135×500mm (Ø5.31"×19.69") | Ø135×1000mm (Ø5.31"×39.37") | Ø135×500mm (Ø5,31"×19.69") | Ø135×1000mm (Ø5.31"×39.37") |
| Net Weight | | 3.8±0.3kg (8.38±0.66Lbs) | 5.4±0.3kg (11.9±0.66Lbs) | 3.8±0.3kg (8.38±0.66Lbs) | 5.4±0.3kg (11.9±0.66Lbs) |
| Working Temperature | Conventional | -20°C to + 45°C(-4°F to +113°F) | | | |
| | With PIR | -20°C to + 40°C(-4°F to +104°F) | | | |
| | DALI | -30°C to + 50°C(-22°F to +122°F) | | | |
| Storing Temperature | | -40°C to + 70°C(-40°F to +158°F) | | | |

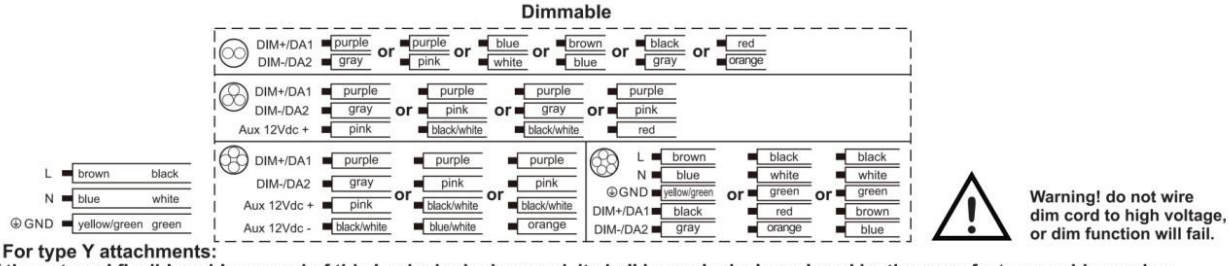



**Warning! do not wire dim cord to high voltage, or dim function will fail.**


- **For type Y attachments:**
**if the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.**
- **The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.**


# Installation Instructions

| Packing List | | |
|---|---|---|
| | Base plate template | 1PC |
| | Screw fixing plate | 1PC |
| | Screw M5*16 | 4PCS |
| | Screw M6 | 3PCS |
| | Nut M6 | 3PCS |

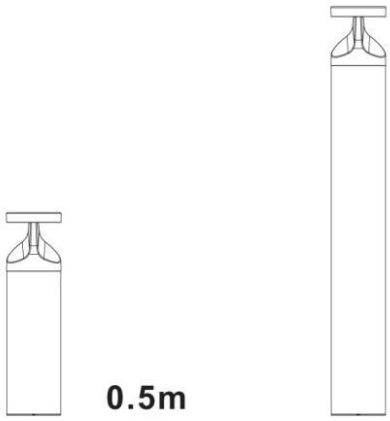



## Physical Dimensions(mm/inch)

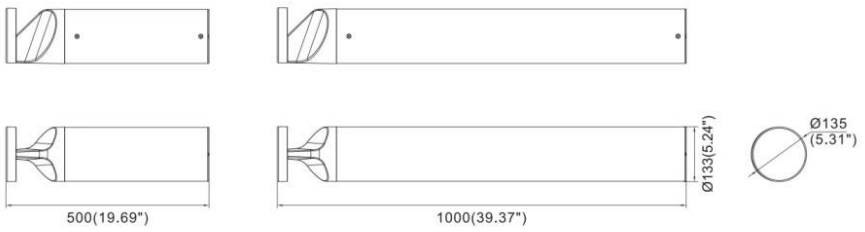

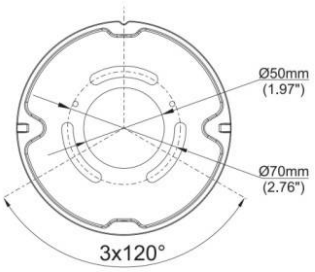

## Installation

①

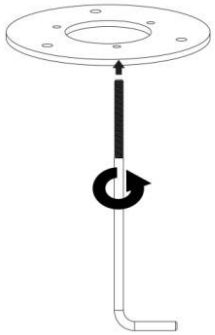


②



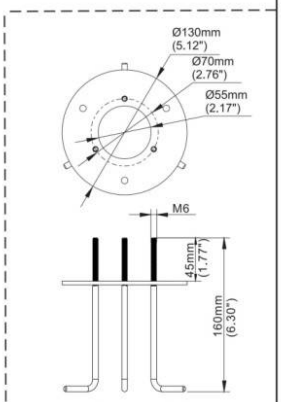


③

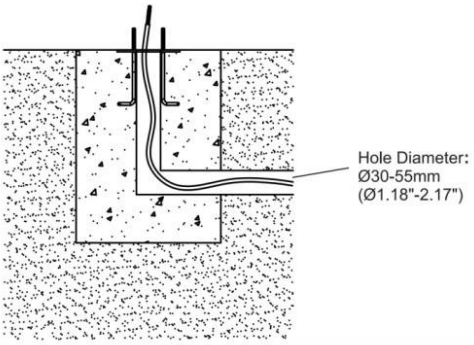


④ Suggested cement column size

